


SIN CORTE DE NEUTRO
NO NEUTRAL SEPARATED
SANS COUPURE DU NEUTRE

Control backup con protección de sobretensión
Backup control with overvoltage protection
Commande backup avec protection contre le surtension

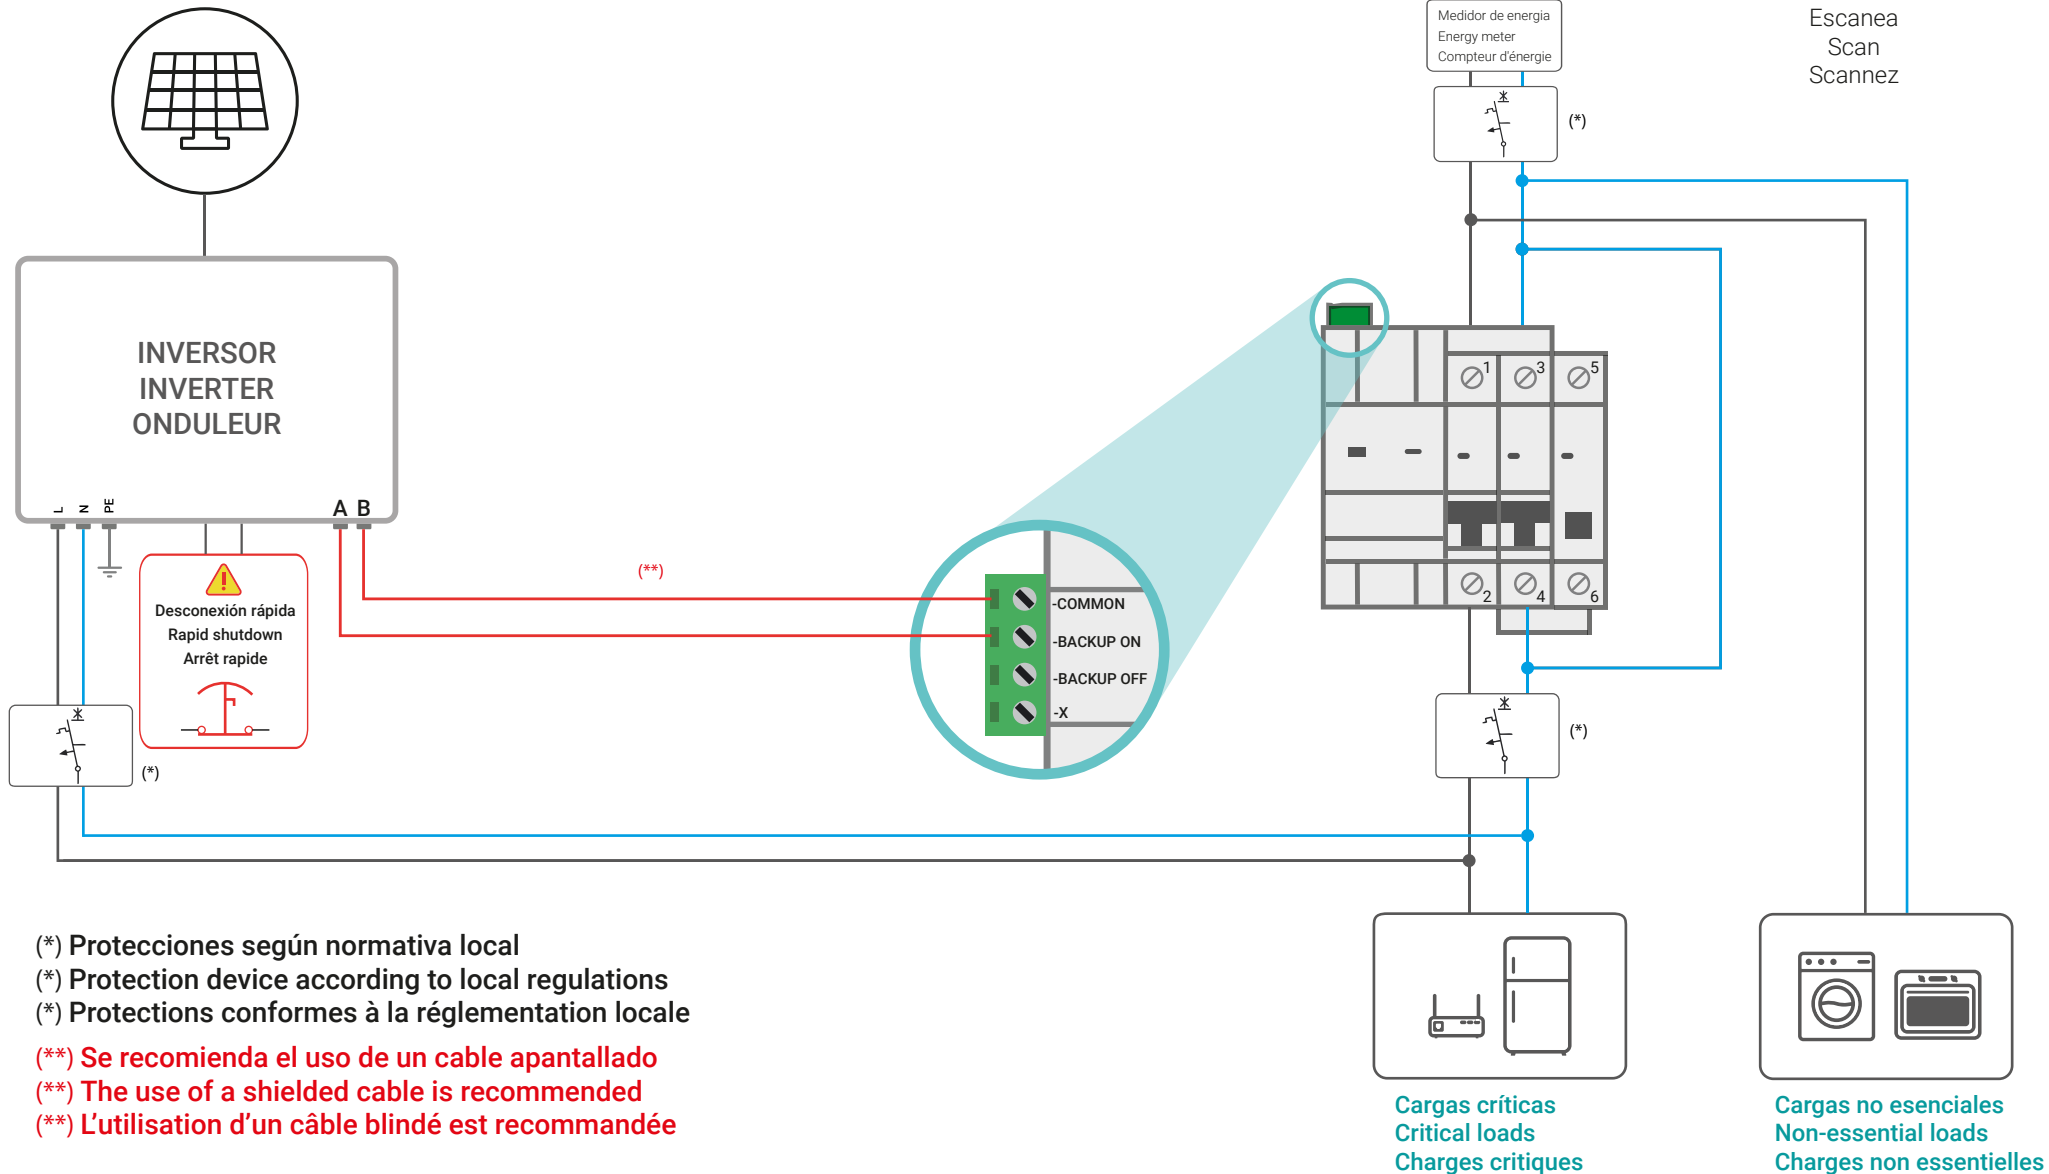

	Terminales Backup del inversor Backup inverter terminals Terminaux backup de l'onduleur	
INVERSOR INVERTER ONDULEUR	A	B
HUAWEI SUN2000-(2KTL...6KTL)-L1 SUN2000-(8K...10K)-LC0 SUN2000-(3K...6K)-LB0	5 GND	8 DI2
KOSTAL PLENTICORE MP G3 (Necesita resistencia de 6,8 kΩ) (Requires a 6.8 kΩ resistor) (Nécessite une résistance de 6,8 kΩ)	GND	In1
GROWATT MIN-(2500...6000)-TL-XH	8	3
SIGENERGY SIGENSTOR SP SIGEN HYBRID SP2	DI1	GND